

NOTES:

A. Protected on only one side exposed to terminals by post shown. Minimum 4" conduit.

4 8-17 EDIT DIMENSIONS

TLA TLA

3 Ø TRANSFORMER CONCRETE PAD
DIMENSIONS AND SPECIFICATIONS
75, 112.5, 150, 225 KVA

JEC

I. GREEN

SCB


HTL

DISTRIBUTION STANDARDS

NSION

REV DATE	DESCRIPTION	BY	D.ENG	D.SUP	D.ENG	BY	APVD	APVD
----------	-------------	----	-------	-------	-------	----	------	------

REVISION

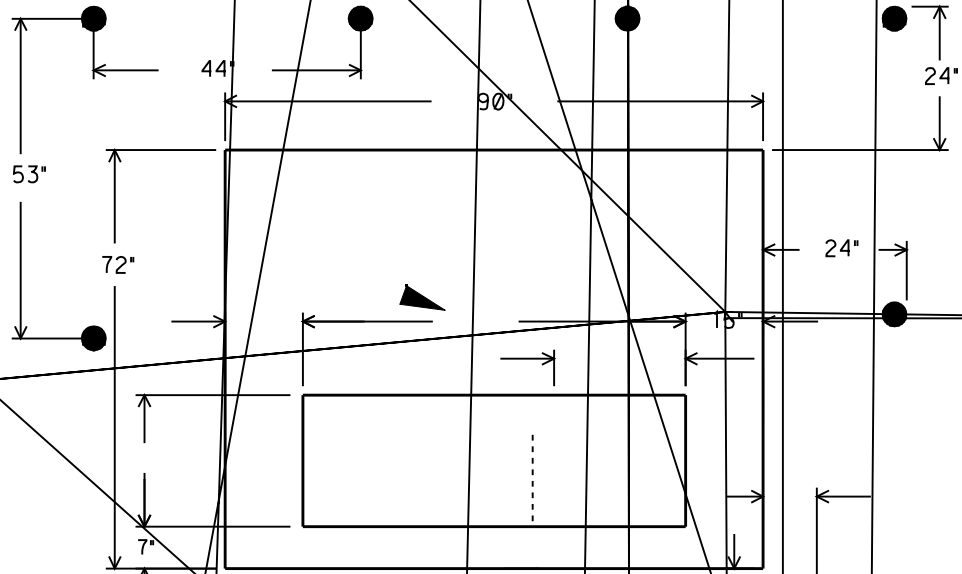

(FRONT)

(12KV TRANSFORMERS ONLY
FOR 34.5KV SEE PT-3)

NOTES:

A. Protected only on side

